

# Warmup WSR Self-Regulating Cable

Freeze Protection and Process Temperature Maintenance for Pipe Tracing Applications

[Non-hazardous and Hazardous Locations]

## Self-Regulating Technology

Automatically adjusts heat output based on operating temperature, ensuring energy efficiency and preventing overheating.

## Process Temperatures up to 150°F (65°C)

Provides reliable freeze protection and temperature maintenance for pipelines in cold environments.

## Range of Approved Accessories

Simplifies installation, ensuring compliance and reducing installation time.

## cCSAus Certified

Guarantees compliance with safety standards, making it suitable for a wide range of applications including hazardous areas.



## Overview

Warmup's WSR Self-Regulating Cable is designed for reliable freeze protection and process temperature maintenance for metallic and non-metallic pipelines. The WSR cable maintains process temperatures up to 150°F (65°C) and can withstand intermittent exposure to temperatures up to 185°F (85°C). It is not suitable for use on pipes that operate a steam purge cycle.

Its advanced positive temperature coefficient [PTC] self-regulating core is positioned between two 16 AWG multi-strand tinned copper bus wires. These are then insulated with a modified polyolefin layer which is wrapped in a tinned copper braid for grounding. The cable's outer jacket, made from modified polyolefin, ensures superior resistance to UV, abrasion, chemical, and mechanical wear, enhancing durability in harsh conditions.

The PTC self-regulating core automatically adjusts heat output in response to temperature changes, delivering more heat as temperatures fall and reducing output as they rise ensuring efficient freeze protection and reliable temperature maintenance for pipelines.

The cable is cCSAus certified for use in both ordinary (non-hazardous) and hazardous locations [see approved applications]. Warmup provides a complete range of system accessories for the WSR cable to ensure fast and hassle-free installation. To maintain cCSAus compliance, only Warmup approved accessories may be used. Refer to the Part Numbers page for guidance.

# Construction

Modified Polyolefin  
Outer Jacket with  
UV Inhibitor

Tinned Copper  
Braid

Modified Polyolefin  
Insulation Layer

Self-Regulating  
Conductive Core

16 AWG Tinned  
Copper Bus Wire



# WSR Approved Applications

| Installation Type / Usage                 |   |   |                             |
|---|---|---|-----------------------------|
| IEEE 515.1                                |   |   | CSA C22.2 No. 130:16        |
| US  | Type examples                                       |   |                             |
| <b>Commercial and Industrial*</b>         | <b>A</b><br>Insulated Surfaces<br>(including pipes) | Hot water lines, Freeze protection, Grease lines, Fuel oil lines, Pre-insulated pipe, Below grade tracing |                             |
|   | <b>B</b><br>Outdoor Exposed Areas†                  | Roof de-icing, Gutter and down spouts de-icing, Catch basins and drains                                   |                             |
| <b>Ordinary and Hazardous Locations ‡</b> | <b>Per US (NEC 500) and CA (CE Code Annex J18)</b>  |   | <b>CSA C22.2 No. 130:16</b> |
|   | Class I, Division 2, Groups A, B, C and D, T5/T6††  | Class II, Division 2, Groups F and G, T5/T6††   |                             |
|   | <b>Per US (NEC 505)</b>                             |   |                             |
|   | Class I, Zone 1 AEx eb IIC T5/T6†† Gb               | Class II, Zone 21 AEx tb IIIC T100°C/T85°C Db   |                             |
|   | <b>Per IECEx/ATEX standards</b>                     |   |                             |
| Ex 60079-30-1 IIC T5/T6†† Gb              | Ex 60079-30-1 IIIC T100°C/T85°C Db                  | <b>Usage: WS</b><br>With wet test and weather resistance  |                             |

\* Commercial includes residential

\*\* Products carrying this designation are also suitable for freeze protection of fire suppression systems.

† 10W/ft cable is not CSA approved for outdoor exposed areas; Roof de-icing, gutter and down spouts de-icing, catch basins and drains

‡ For hazardous locations, WSR self-regulating cable may only be installed with Warmup accessories approved for hazardous locations [See WSR Approved Accessories]

†† T5 sets power output for WSR 12 W/ft cable; T6 sets power outputs for WSR 5, 8, and 10W/ft cable


# Technical Specifications

| Model  | WSR- <b>&lt;a&gt;</b> W- <b>&lt;c&gt;</b> - <b>&lt;XXX&gt;</b> d                  |   |  |  |   |
|--|---|---|--|--|---|
|  | WSR- <b>&lt;a&gt;</b> <b>&lt;b&gt;</b> W- <b>&lt;c&gt;</b> - <b>&lt;XXX&gt;</b> d |   |  |  |   |
| Code   | <b>&lt;a&gt; = 5, 8, 10 W/ft</b><br><i>W/ft insulated pipe<br/>@50°F (10°C)</i>   | <b>&lt;b&gt; = 9, 12, 15 W/ft</b><br><i>W/ft in water<br/>@32°F (0°C)</i>   | <b>&lt;c&gt; = 1 / 2</b><br>1 = 110-120 V AC<br>2 = 208-277 V AC | <b>&lt;XXX&gt; = 250,<br/>500 or 1000ft</b><br><i>Cable length</i> | <b>&lt;d&gt; = CR</b><br><i>Outer jacket<br/>material</i> |
| <b>Power Output</b>                                      | WSR-5W  | 5.0 W/ft (16.4 W/m) @50°F (10°C Insulated Pipe)<br>6.0 W/ft (19.6 W/m) @32°F (0°C Air)<br>8.9 W/ft (29.2 W/m) @32°F (0°C Water)   |  |  |   |
|  | WSR-8W  | 8.1 W/ft (26.5 W/m) @50°F (10°C Insulated Pipe)<br>8.7 W/ft (28.4 W/m) @32°F (0°C Air)<br>12.8 W/ft (42.1 W/m) @32°F (0°C Water)  |  |  |   |
|  | WSR-10W *   | 9.3 W/ft (30.5 W/m) @50°F (10°C Insulated Pipe)<br>10.5 W/ft (34.3 W/m) @32°F (0°C Air)<br>15.3 W/ft (50.2 W/m) @32°F (0°C Water) |  |  |   |
| <b>Operating Voltage</b>                                 | 110 - 120 V AC / 208 - 277 V AC   |   |  |  |   |
| <b>Minimum Bend Radius</b>                               | 1¼" (30 mm)   |   |  |  |   |
| <b>Minimum Installation Temperature</b>                  | - 40 °F (- 40 °C)   |   |  |  |   |
| <b>Maximum Continuous Operating Temperature</b>          | + 150 °F (65 °C)  |   |  |  |   |
| <b>Maximum Intermittent Exposure Temperature</b>         | + 185 °F (85 °C)  |   |  |  |   |
| <b>Maximum Operating Current</b>                         | 40A (Pipe tracing)<br>20A (Roof & gutter applications)                            |   |  |  |   |
| <b>Protective Braid Resistance</b>                       | < 29 Ω/mi (18.2 Ω/km)   |   |  |  |   |
| <b>Required Ground Fault Equipment Protection (GFEP)</b> | 30mA  |   |  |  |   |
| <b>Dimensions</b>  | ½" (12.6 mm) (W) x ¼" (6.0 mm) (T)  |   |  |  |   |
| <b>Specific Weight</b>                                   | 1.16 oz/ft (108 g/m)  |   |  |  |   |
| <b>Warranty</b>  | 10 Years  |   |  |  |   |


\* 10W/ft cable is not CSA approved for outdoor exposed areas; Roof de-icing, gutter and down spouts de-icing, catch basins and drains

# Power Output Curves

Specific Power Output on Pipe: WSR-xW-1

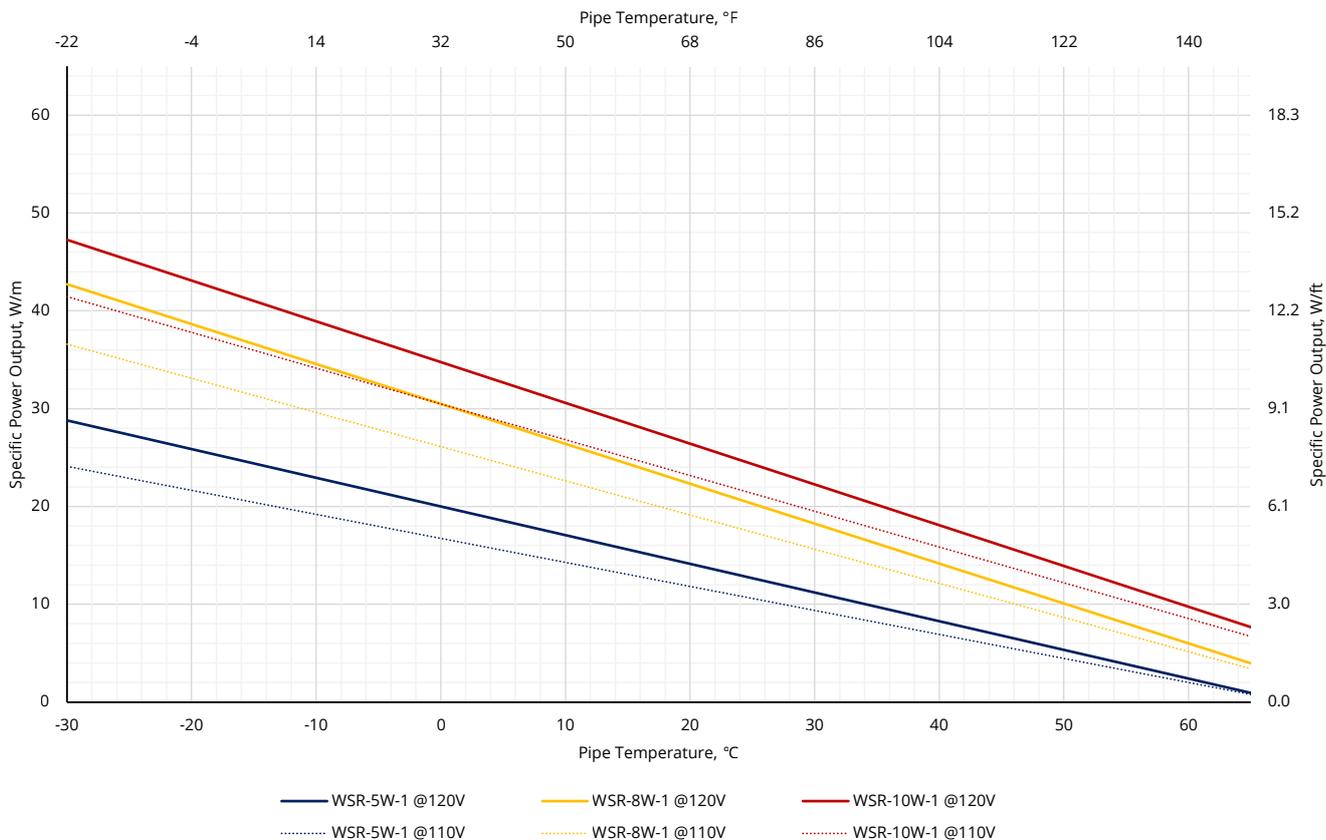


Specific Power Output on Pipe: WSR-xW-2

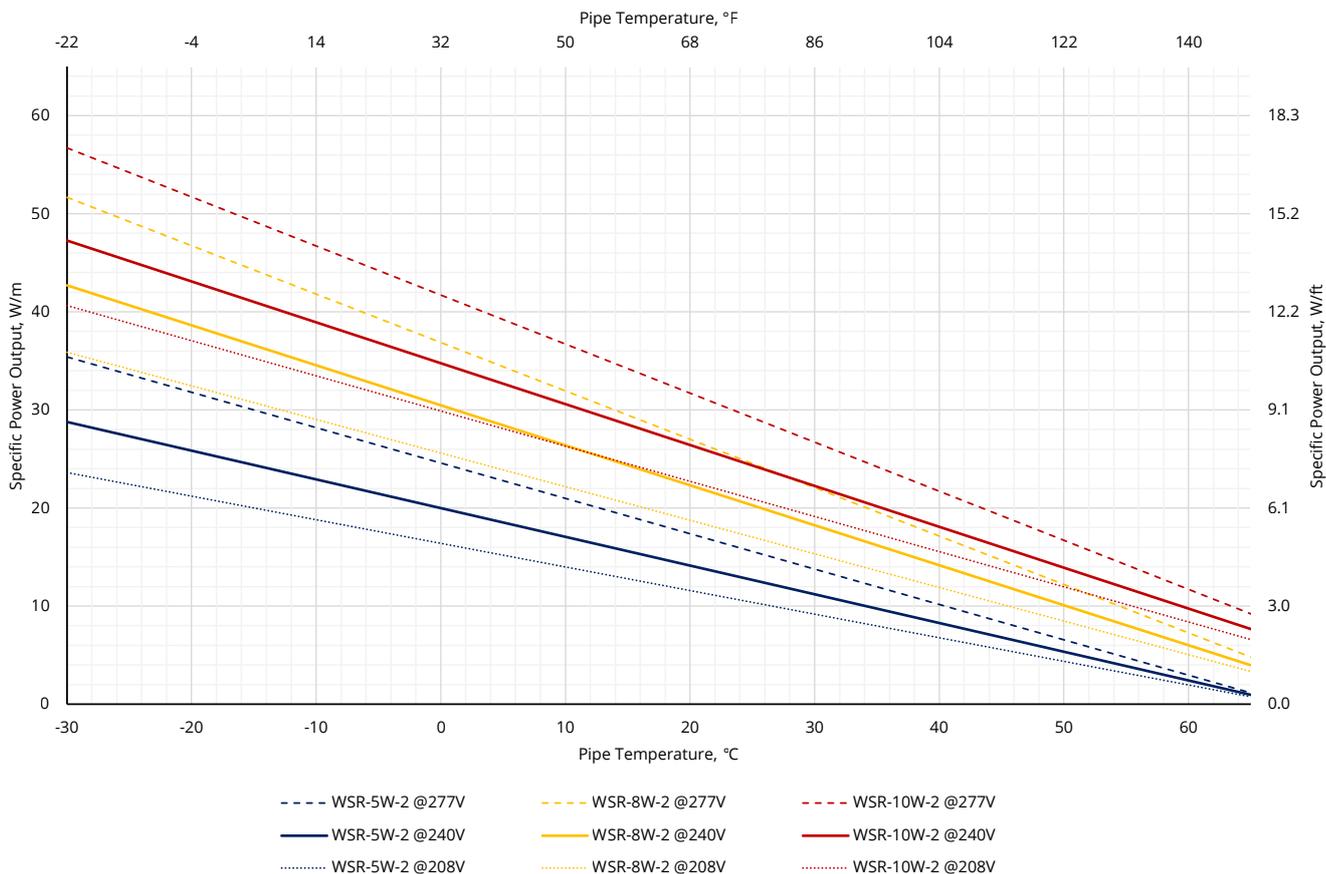


# Power Output Curves

## Specific Power Output in Water: WSR-xW-1

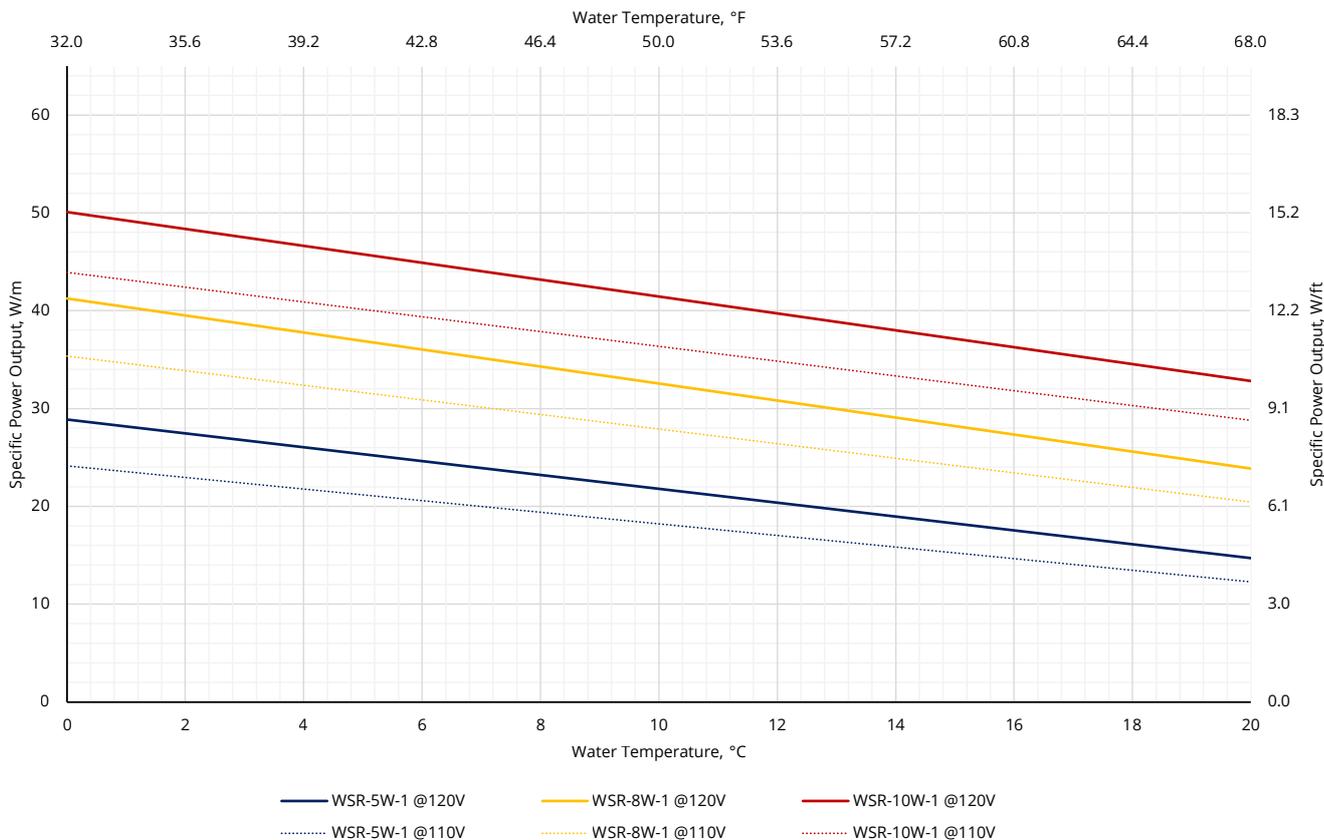


## Specific Power Output in Water: WSR-xW-2

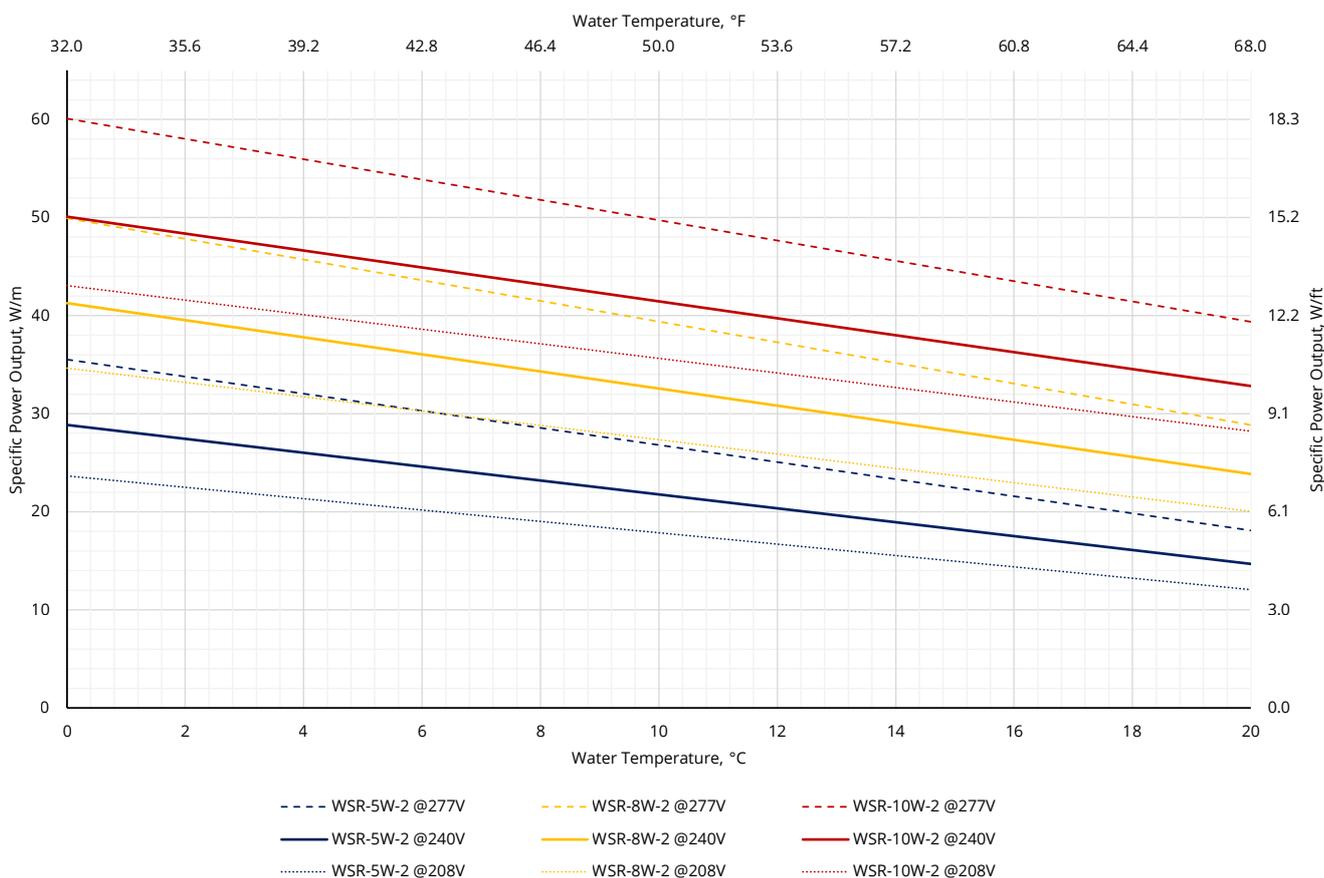


# Power Output Curves

## Specific Power Output in Air: WSR-xW-1

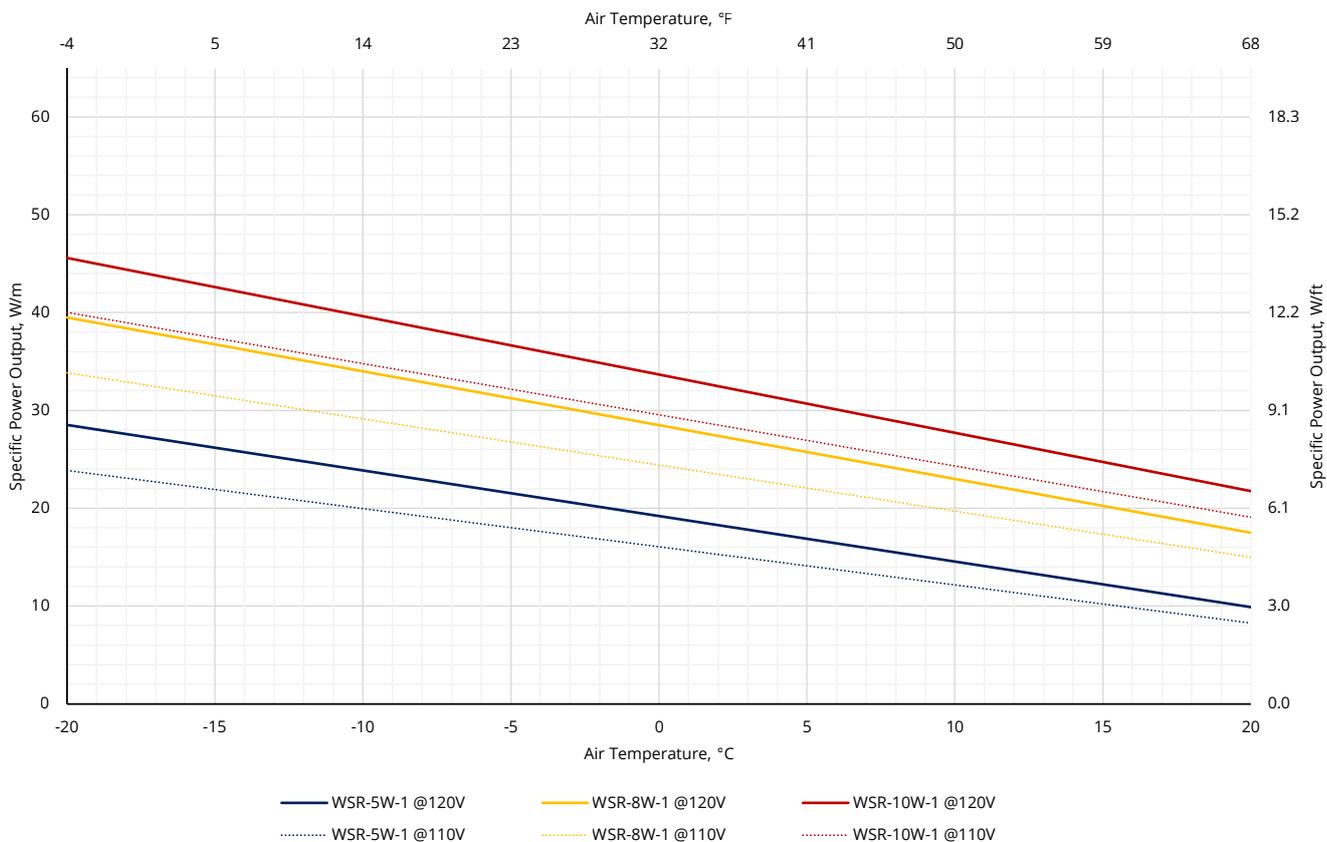

## Specific Power Output in Air: WSR-xW-2

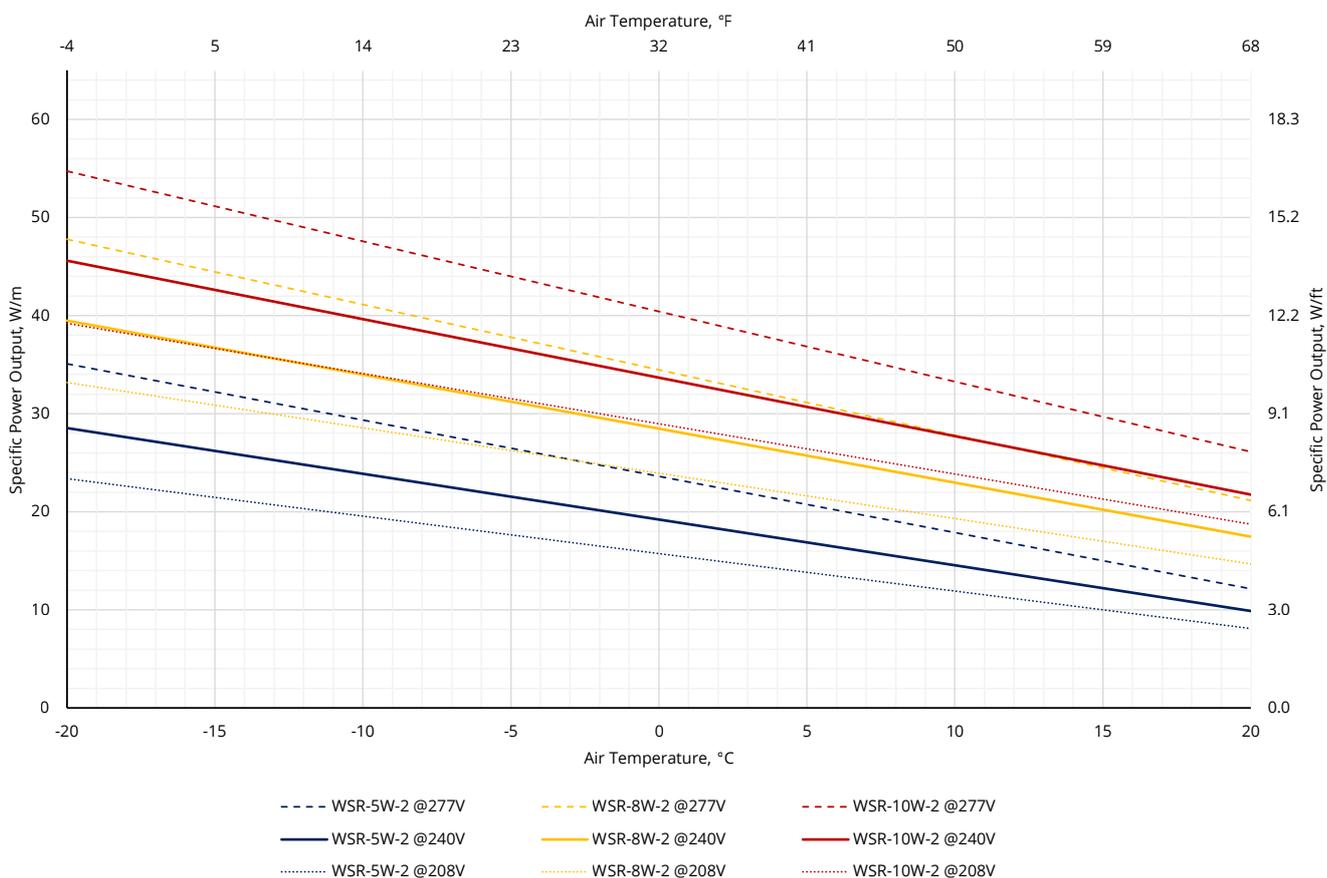

# Circuit Breaker Sizing

|                                   |                                       | 120 V |     |     |     |     | 208 V |     |     |     |     | 240 V |     |     |     |     | 277 V |     |     |     |     |  |
|-----------------------------------|---------------------------------------|-------|-----|-----|-----|-----|-------|-----|-----|-----|-----|-------|-----|-----|-----|-----|-------|-----|-----|-----|-----|--|
| Code                              | Min. Start-up Temp.                   | 15A   | 20A | 30A | 40A | 50A | 15A   | 20A | 30A | 40A | 50A | 15A   | 20A | 30A | 40A | 50A | 15A   | 20A | 30A | 40A | 50A |  |
| <b>Maximum Circuit Length, ft</b> |                                       |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |  |
| WSR-5W                            | 50°F (10°C)                           | 249   | 249 | 249 | 249 | 249 | 515   | 515 | 515 | 515 | 515 | 499   | 499 | 499 | 499 | 499 | 422   | 485 | 485 | 485 | 485 |  |
|                                   | 32°F (0°C)                            | 236   | 238 | 238 | 238 | 238 | 491   | 491 | 491 | 491 | 491 | 471   | 476 | 476 | 476 | 476 | 383   | 462 | 462 | 462 | 462 |  |
|                                   | 14°F (-10°C)                          | 218   | 228 | 228 | 228 | 228 | 472   | 472 | 472 | 472 | 472 | 436   | 456 | 456 | 456 | 456 | 354   | 445 | 445 | 445 | 445 |  |
|                                   | -4°F (-20°C)                          | 201   | 220 | 220 | 220 | 220 | 453   | 453 | 453 | 453 | 453 | 402   | 440 | 440 | 440 | 440 | 327   | 427 | 427 | 427 | 427 |  |
|                                   | -40°F (-40°C)                         | 174   | 203 | 203 | 203 | 203 | 421   | 421 | 421 | 421 | 421 | 347   | 407 | 407 | 407 | 407 | 282   | 377 | 397 | 397 | 397 |  |
|                                   | <b>Maximum Circuit Length, meters</b> |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |  |
|                                   | 50°F (10°C)                           | 76    | 76  | 76  | 76  | 76  | 157   | 157 | 157 | 157 | 157 | 152   | 152 | 152 | 152 | 152 | 129   | 148 | 148 | 148 | 148 |  |
|                                   | 32°F (0°C)                            | 72    | 72  | 72  | 72  | 72  | 150   | 150 | 150 | 150 | 150 | 144   | 145 | 145 | 145 | 145 | 117   | 141 | 141 | 141 | 141 |  |
|                                   | 14°F (-10°C)                          | 66    | 69  | 69  | 69  | 69  | 144   | 144 | 144 | 144 | 144 | 133   | 139 | 139 | 139 | 139 | 108   | 136 | 136 | 136 | 136 |  |
|                                   | -4°F (-20°C)                          | 61    | 67  | 67  | 67  | 67  | 138   | 138 | 138 | 138 | 138 | 122   | 134 | 134 | 134 | 134 | 100   | 130 | 130 | 130 | 130 |  |
| -40°F (-40°C)                     | 53                                    | 62    | 62  | 62  | 62  | 128 | 128   | 128 | 128 | 128 | 106 | 124   | 124 | 124 | 124 | 86  | 115   | 121 | 121 | 121 |     |  |
| <b>Maximum Circuit Length, ft</b> |                                       |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |  |
| WSR-8W                            | 50°F (10°C)                           | 165   | 198 | 198 | 198 | 198 | 393   | 406 | 406 | 406 | 406 | 330   | 397 | 397 | 397 | 397 | 273   | 364 | 390 | 390 | 390 |  |
|                                   | 32°F (0°C)                            | 150   | 190 | 190 | 190 | 190 | 358   | 387 | 387 | 387 | 387 | 301   | 380 | 380 | 380 | 380 | 248   | 331 | 372 | 372 | 372 |  |
|                                   | 14°F (-10°C)                          | 138   | 182 | 182 | 182 | 182 | 328   | 371 | 371 | 371 | 371 | 276   | 364 | 364 | 364 | 364 | 228   | 304 | 356 | 356 | 356 |  |
|                                   | -4°F (-20°C)                          | 127   | 170 | 174 | 174 | 174 | 303   | 356 | 356 | 356 | 356 | 255   | 339 | 348 | 348 | 348 | 210   | 280 | 343 | 343 | 343 |  |
|                                   | -40°F (-40°C)                         | 110   | 147 | 162 | 162 | 162 | 263   | 332 | 332 | 332 | 332 | 221   | 294 | 325 | 325 | 325 | 182   | 243 | 319 | 319 | 319 |  |
|                                   | <b>Maximum Circuit Length, meters</b> |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |  |
|                                   | 50°F (10°C)                           | 50    | 60  | 60  | 60  | 60  | 120   | 124 | 124 | 124 | 124 | 101   | 121 | 121 | 121 | 121 | 83    | 111 | 119 | 119 | 119 |  |
|                                   | 32°F (0°C)                            | 46    | 58  | 58  | 58  | 58  | 109   | 118 | 118 | 118 | 118 | 92    | 116 | 116 | 116 | 116 | 76    | 101 | 113 | 113 | 113 |  |
|                                   | 14°F (-10°C)                          | 42    | 55  | 55  | 55  | 55  | 100   | 113 | 113 | 113 | 113 | 84    | 111 | 111 | 111 | 111 | 69    | 93  | 109 | 109 | 109 |  |
|                                   | -4°F (-20°C)                          | 39    | 52  | 53  | 53  | 53  | 92    | 109 | 109 | 109 | 109 | 78    | 103 | 106 | 106 | 106 | 64    | 85  | 104 | 104 | 104 |  |
| -40°F (-40°C)                     | 34                                    | 45    | 49  | 49  | 49  | 80  | 101   | 101 | 101 | 101 | 67  | 90    | 99  | 99  | 99  | 56  | 74    | 97  | 97  | 97  |     |  |
| <b>Maximum Circuit Length, ft</b> |                                       |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |  |
| WSR-10W                           | 50°F (10°C)                           | 120   | 160 | 175 | 175 | 175 | 279   | 355 | 355 | 355 | 355 | 240   | 320 | 351 | 351 | 351 | 200   | 266 | 347 | 347 | 347 |  |
|                                   | 32°F (0°C)                            | 109   | 145 | 167 | 167 | 167 | 253   | 337 | 338 | 338 | 338 | 218   | 290 | 335 | 335 | 335 | 181   | 242 | 331 | 331 | 331 |  |
|                                   | 14°F (-10°C)                          | 100   | 133 | 161 | 161 | 161 | 232   | 309 | 324 | 324 | 324 | 199   | 266 | 321 | 321 | 321 | 166   | 221 | 316 | 316 | 316 |  |
|                                   | -4°F (-20°C)                          | 92    | 122 | 154 | 154 | 154 | 214   | 285 | 311 | 311 | 311 | 184   | 245 | 308 | 308 | 308 | 153   | 204 | 304 | 304 | 304 |  |
|                                   | -40°F (-40°C)                         | 80    | 106 | 143 | 143 | 143 | 185   | 247 | 290 | 290 | 290 | 160   | 213 | 285 | 285 | 285 | 133   | 177 | 266 | 283 | 283 |  |
|                                   | <b>Maximum Circuit Length, meters</b> |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |       |     |     |     |     |  |
|                                   | 50°F (10°C)                           | 37    | 49  | 53  | 53  | 53  | 85    | 108 | 108 | 108 | 108 | 73    | 97  | 107 | 107 | 107 | 61    | 81  | 106 | 106 | 106 |  |
|                                   | 32°F (0°C)                            | 33    | 44  | 51  | 51  | 51  | 77    | 103 | 103 | 103 | 103 | 66    | 88  | 102 | 102 | 102 | 55    | 74  | 101 | 101 | 101 |  |
|                                   | 14°F (-10°C)                          | 30    | 40  | 49  | 49  | 49  | 71    | 94  | 99  | 99  | 99  | 61    | 81  | 98  | 98  | 98  | 51    | 67  | 96  | 96  | 96  |  |
|                                   | -4°F (-20°C)                          | 28    | 37  | 47  | 47  | 47  | 65    | 87  | 95  | 95  | 95  | 56    | 75  | 94  | 94  | 94  | 47    | 62  | 93  | 93  | 93  |  |
| -40°F (-40°C)                     | 24                                    | 32    | 43  | 43  | 43  | 57  | 75    | 88  | 88  | 88  | 49  | 65    | 87  | 87  | 87  | 41  | 54    | 81  | 86  | 86  |     |  |

**NOTE:** Maximum Circuit Length is limited by; circuit breaker size (80% Capacity), in-rush current and voltage drop.

# Part Numbers

## WSR Self-Regulating Cable

| Model             | Code                 | Voltage     | Cable Length | Power Output<br><i>W/ft insulated pipe @50°F (10°C);<br/>W/ft in water @32°F (0°C)</i> |
|-------------------|----------------------|-------------|--------------|--|
| WSR-5W-1-250-CR   | WSR-5/9W-1-250-CR    | 110-120 VAC | 250 ft       | 5.0 W/ft (8.9 W/ft)  |
| WSR-5W-1-500-CR   | WSR-5/9W-1-500-CR    | 110-120 VAC | 500 ft       | 5.0 W/ft (8.9 W/ft)  |
| WSR-5W-1-1000-CR  | WSR-5/9W-1-1000-CR   | 110-120 VAC | 1000 ft      | 5.0 W/ft (8.9 W/ft)  |
| WSR-5W-2-250-CR   | WSR-5/9W-2-250-CR    | 208-277 VAC | 250 ft       | 5.0 W/ft (8.9 W/ft)  |
| WSR-5W-2-500-CR   | WSR-5/9W-2-500-CR    | 208-277 VAC | 500 ft       | 5.0 W/ft (8.9 W/ft)  |
| WSR-5W-2-1000-CR  | WSR-5/9W-2-1000-CR   | 208-277 VAC | 1000 ft      | 5.0 W/ft (8.9 W/ft)  |
| WSR-8W-1-250-CR   | WSR-8/12W-1-250-CR   | 110-120 VAC | 250 ft       | 8.1 W/ft (12.8 W/ft)   |
| WSR-8W-1-500-CR   | WSR-8/12W-1-500-CR   | 110-120 VAC | 500 ft       | 8.1 W/ft (12.8 W/ft)   |
| WSR-8W-1-1000-CR  | WSR-8/12W-1-1000-CR  | 110-120 VAC | 1000 ft      | 8.1 W/ft (12.8 W/ft)   |
| WSR-8W-2-250-CR   | WSR-8/12W-2-250-CR   | 208-277 VAC | 250 ft       | 8.1 W/ft (12.8 W/ft)   |
| WSR-8W-2-500-CR   | WSR-8/12W-2-500-CR   | 208-277 VAC | 500 ft       | 8.1 W/ft (12.8 W/ft)   |
| WSR-8W-2-1000-CR  | WSR-8/12W-2-1000-CR  | 208-277 VAC | 1000 ft      | 8.1 W/ft (12.8 W/ft)   |
| WSR-10W-1-250-CR  | WSR-10/15W-1-250-CR  | 110-120 VAC | 250 ft       | 9.3 W/ft (15.3 W/ft)   |
| WSR-10W-1-500-CR  | WSR-10/15W-1-500-CR  | 110-120 VAC | 500 ft       | 9.3 W/ft (15.3 W/ft)   |
| WSR-10W-1-1000-CR | WSR-10/15W-1-1000-CR | 110-120 VAC | 1000 ft      | 9.3 W/ft (15.3 W/ft)   |
| WSR-10W-2-250-CR  | WSR-10/15W-2-250-CR  | 208-277 VAC | 250 ft       | 9.3 W/ft (15.3 W/ft)   |
| WSR-10W-2-500-CR  | WSR-10/15W-2-500-CR  | 208-277 VAC | 500 ft       | 9.3 W/ft (15.3 W/ft)   |
| WSR-10W-2-1000-CR | WSR-10/15W-2-1000-CR | 208-277 VAC | 1000 ft      | 9.3 W/ft (15.3 W/ft)   |

## WSR Approved Accessories

| Model                | Description   | Classification  | Application                   |
|----------------------|---|---|-------------------------------|
| SR-SFIT-BOX-S        | Power Connection Box for connecting WSR to supply   | <b>Non-Hazardous &amp; Hazardous Locations</b><br><i>Ex eb IIC T3 Gb,<br/>Ex tb IIIC T200°C Db<br/>Class I, Zone 1, AEx eb IIC T3 Gb<br/>Class II, Zone 21, AEx tb IIIC T200°C Db<br/>Class I, Division 2, Groups A, B, C and D T3<br/>Class II, Division 2, Groups F, G T3</i> | Pipe Tracing<br>Roof & Gutter |
| SR-SFIT-SPL          | Splice Connection kit for In-line Splice of WSR cable   |   |                               |
| SR-SFIT-TEE          | Tee Splice Connection kit for Tee Splice of WSR cable   |   |                               |
| SR-END-KIT           | End-Seal Termination kit for WSR cable termination  |   |                               |
| SR-LENDCAP           | Lighted End Kit for WSR cable termination, giving visual indicator when WSR cable is active.<br><b>Certified for use at 120V or 240V AC only.</b> | <b>Non-Hazardous &amp; Hazardous Locations</b><br><i>Class I, Division 2, Groups A, B, C and D;<br/>Class II, Division 2, Groups F and G;<br/>Class III; T5 or T6</i>   | Pipe Tracing<br>Roof & Gutter |
| SR-POWER-KIT         | Power Connection Kit for WSR cable, incl. components for 1 power connection, 1 termination. Incl. 1 pipe standoff bracket.                        | <b>Non-Hazardous Locations</b>  | Pipe Tracing<br>Roof & Gutter |
| CRDS-15-GFCI         | Plug-in, ground-fault-circuit interrupter [GFCI] power connection kit with 5-15P type plug for Warmup's WSR<br><b>120V Self-Regulating Cable</b>  | <b>Non-Hazardous Locations</b>  | Pipe Tracing<br>Roof & Gutter |
| SR-SPLICE-KIT        | Splice/Tee Kit for WSR cable. Incl. components for 1 Splice and 1 End Seal, or 1 Tee Connection and 1 End Seal                                    | <b>Non-Hazardous Locations</b>  | Pipe Tracing<br>Roof & Gutter |
| SR-ROOF-CLIP(50/BAG) | Metal single roof clips (50/BAG) to secure WSR cable  | <b>Non-Hazardous Locations</b>  | Roof & Gutter                 |
| SR-HANGER-KIT        | Downspout Hanger for WSR cable  | <b>Non-Hazardous Locations</b>  | Roof & Gutter                 |

# Product Markings

Trade mark;  
Product type

WARMUP | PARALLEL SELF-REGULATING CABLE

Model

WSR-**<a>W-*<c>-<XXX>d***

Code

WSR-**<a><b>W-*<c>-<XXX>d***

|   |   |  |   |   |
|---|---|--|---|---|
| <b>&lt;a&gt; = 5, 8, 10 W/ft</b><br>W/ft insulated pipe<br>@50°F (10°C) | <b>&lt;b&gt; = 9, 12, 15 W/ft</b><br>W/ft in water<br>@32°F (0°C) | <b>&lt;c&gt; = 1 / 2</b><br>1 = 110-120 V AC<br>2 = 208-277 V AC | <b>&lt;XXX&gt; = 250, 500<br/>or 1000ft</b><br>Cable length | <b>&lt;d&gt; = CR</b><br>Outer jacket<br>material |
|---|---|--|---|---|

Voltage Rating

VOLTAGE: **AAA - BBB** VAC

**AAA** = 110 / 208; **BBB** = 120 / 277

Wattage Rating

**<#>W/FT (<#>W/m)** @50°F (10°C ON PIPE)

**<#>** = Specific power in air @50°F (10°C)

**<##>W/FT (<##>W/m)** @32°F (0°C WATER)

**<#>** = Specific power in water @32°F (0°C)

**<###>W/FT (<###>W/m)** @32°F (0°C AIR)

**<###>** = Specific power in air @32°F (0°C)

Approval



**268591**

**- WS**

CSA File Number

Usage marking;  
With wet test and weather resistance

Hazardous Location  
Info.

**HAZ LOC CLASS I, DIV. 2, GROUPS A, B, C and D T5/T6 | CLASS II, DIV. 2, GROUPS F and G T5/T6 | CLASS I, ZONE 1 AEx eb IIC T5/T6 Gb | CLASS II, ZONE 21 AEx tb IIIC T100°C/T85°C Db | Ex 60079-30-1 IIC T5/T6 Gb | Ex 60079-30-1 IIIC T100°C/T85°C Db**

\* See Guide on Hazardous Locations

Max. Temperature  
Rating

MAX. MAINT. TEMP 149°F (65°C)

Minimum Installation  
Temperature

- 40 °F (- 40 °C)

Amperage Rating

MAX. AMPS 40\*\*

\*\* 40A rating is specific for pipe tracing applications only;

**Outdoor exposed areas;** Roof de-icing, Gutter and down spouts de-icing, Catch basins and drains applications are rated at a maximum of 20A

Warning

DE-ENERGIZE CIRCUIT BEFORE SERVICING

Batch Number

Specific code marked on cable for traceability purposes

Feet Marking

250, 500 or 1000ft

## Contact

Warmup is available 24/7/365 at (888) 927-6333

For quotes, layouts and specific technical information contact us at:

**Warmup Inc**

www.warmup.com

us@warmup.com

T: +1 (888) 927-6333

**Warmup Canada**

www.warmup.com

ca@warmup.com

T: 1+ (888) 592-7687

25 Francis J Clarke Cir, Bethel,  
CT 06801

Please be advised Warmup Inc., provides these technical specifications and or instructions on a self help basis. We take every precaution to ensure they are accurate. Some of the products are sourced from manufacturers and we relay that information on to you. We do not have the technical specifications reviewed by an engineer and sometimes errors do happen. Our products are only reviewed with an ordinary level of care and when using said products in a situation that warrants additional care please be sure to conduct your own review. As such we strongly suggest before installing our products you have them reviewed by a professional engineer or qualified professional. We under no circumstances warrant our products for a particular use unless specifically agreed in writing.

# Guide to Hazardous Locations\*

---

## **A Class I, Division 2 location is a location:**

- (i) In which volatile flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors are handled, processed, or used, but in which the liquids, vapors, or gases will normally be confined within closed containers or closed systems from which they can escape only in case of accidental rupture or breakdown of such containers or systems or in case of abnormal operation of equipment, or
- (ii) In which ignitable concentrations of flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors are normally prevented by positive mechanical ventilation and which might become hazardous through failure or abnormal operation of the ventilating equipment, or
- (iii) That is adjacent to a Class I, Division 1 location, and to which ignitable concentrations of flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors above their flash points might occasionally be communicated unless such communication is prevented by adequate positive-pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

---

## **Class I Group Classifications**

**A** Acetylene

**B** Flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value less than or equal to 0.45 mm or a minimum igniting current ratio (MIC ratio) less than or equal to 0.40

**C** Flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value greater than 0.45 mm and less than or equal to 0.75 mm, or a minimum igniting current (MIC) ratio greater than 0.40 and less than or equal to 0.80.

**D** Flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value greater than 0.75 mm or a minimum igniting current (MIC) ratio greater than 0.80.

---

## **A Class II, Division 2 location is a location:**

- (i) In which combustible dust due to abnormal operations may be present in the air in quantities sufficient to produce explosive or ignitable mixtures; or
- (ii) Where combustible dust accumulations are present but are normally insufficient to interfere with the normal operation of electrical equipment or other apparatus, but could as a result of infrequent malfunctioning of handling or processing equipment become suspended in the air; or
- (iii) In which combustible dust accumulations on, in, or in the vicinity of the electrical equipment could be sufficient to interfere with the safe dissipation of heat from electrical equipment, or could be ignitable by abnormal operation or failure of electrical equipment.

---

## **Class II Combustible Dust Group Classifications**

**F** Atmospheres containing combustible carbonaceous dusts that have more than 8 percent total entrapped volatiles (see ASTM D3175-2017, Standard Test Method for Volatile Matter in the Analysis Sample of Coal and Coke, for coal and coke dusts) or that have been sensitized by other materials so that they present an explosion hazard. [499:3.3.9.1.2] Although coal, carbon black, charcoal, and coke dusts are examples of carbonaceous dusts only those atmospheres containing combustible carbonaceous dust that have more than 8 percent total entrapped volatiles are Class II, Group F.

**G** Atmospheres containing combustible dusts not included in Group E or Group F, including flour, grain, wood, plastic, and chemicals.

---

## **Equipment Temperature Class**

The temperature class or operating temperature at a 104°F (40°C) ambient temperature, or at the higher ambient temperature if the equipment is rated and marked for an ambient temperature of greater than 104°F (40°C).

**T3** = ≤ 392°F (≤ 200°C); **T5** = 212°F (≤ 100°C); **T6** = ≤ 185°F (≤ 85°C)

---

## **A Zone 1 location is a location**

- (i) In which ignitable concentrations of flammable gases or vapors are likely to exist under normal operating conditions; or
- (ii) In which ignitable concentrations of flammable gases or vapors may exist frequently because of repair or maintenance operations or because of leakage; or
- (iii) In which equipment is operated or processes are carried on, of such a nature that equipment breakdown or faulty operations could result in the release of ignitable concentrations of flammable gases or vapors and also cause simultaneous failure of electrical equipment in a mode to cause the electrical equipment to become a source of ignition; or
- (iv) That is adjacent to a Zone 0 location from which ignitable concentrations of vapors could be communicated, unless communication is prevented by adequate positive pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

# Guide to Hazardous Locations\*

---

## A Zone 21 location is a location where one of the following apply:

- (i) Ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings are likely to exist occasionally under normal operating conditions.
- (ii) Ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings might exist frequently because of repair or maintenance operations or because of leakage.
- (iii) Equipment is operated or processes are carried on of such a nature that equipment breakdown or faulty operations could result in the release of ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings and also cause simultaneous failure of electrical equipment in a mode to cause the electrical equipment to become a source of ignition.
- (iii) The location is adjacent to a Zone 20 location from which ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings could be communicated.  
*Exception: When communication from an adjacent Zone 20 location is minimized by adequate positive pressure ventilation from a source of clean air, and effective safeguards against ventilation failure are provided.*
- (iv) Group IIIC combustible dusts are present in hazardous quantities occasionally, under normal or abnormal operating conditions, or frequently because of repair or maintenance operations or because of leakage.

---

## Symbols explained

**AEx** The symbol AEx identifies the equipment as meeting American national standards. The symbol Ex is used in European Union countries. Only equipment marked AEx has been evaluated for use in electrical systems and hazardous locations covered by the NEC

---

## Equipment Suitable for Hazardous (Classified) Locations

| Mark      | NEC Area Classification | Type (Level) of Protection          |
|-----------|-------------------------|-------------------------------------|
| <b>eb</b> | Zone 1                  | Increased safety (Group II)         |
| <b>tb</b> | Zone 21                 | Protection by enclosure (Group III) |

---

## Equipment Protection Level

The EPL indicates the level of protection provided by the equipment and is correlated to the zone in which the equipment will be installed and operated.

| Mark      | NEC Area Classification | Type (Level) of Protection   |
|-----------|-------------------------|--|
| <b>Gb</b> | Zone 1                  | equipment for explosive gas atmospheres, having a "high" Level of Protection, which is not a source of ignition in normal operation or during expected malfunctions  |
| <b>Db</b> | Zone 21                 | equipment for explosive dust atmospheres, having a "high" Level of Protection, which is not a source of ignition in normal operation or during expected malfunctions |

---

## Material Groups

**IIC** Group IIC: Atmospheres containing acetylene, hydrogen, or flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value less than or equal to 0.50 mm or minimum igniting current (MIC) ratio less than or equal to 0.45.

**IIIC** Group IIIC: Combustible metal dust, including combustible metal fibers/flyings.

*Equipment marked Group IIIC shall be permitted for applications requiring Group IIIA or Group IIIB equipment.*

---

## IECEx/ATEX standards

**Ex** The symbol Ex is used in European Union countries.

**60079-30-1** STANDARD FOR SAFETY  
Explosive Atmospheres – Part 30-1: Electrical Resistance Trace Heating – General and Testing Requirements

---

\* This guide is provided for reference purposes only. It summarizes typical classifications and installation types based on information from the National Electrical Code (NEC), Canadian Electrical Code (CEC), and relevant international standards.

**This guide does not replace or supersede any official code or standard.** For the most accurate and up-to-date requirements, always consult the NEC, CEC, and applicable local regulations, as well as the latest versions of IECEx/ATEX standards. Installation in hazardous locations must comply with all certification conditions and use only Warmup approved accessories as specified in the product documentation.