

# Warmup WSR Self-Regulating Cable

Snow & Ice Melting for Roof & Gutter Trace Applications

## Self-Regulating Technology

Automatically adjusts heat output based on operating temperature, ensuring energy efficiency and preventing overheating.

## Engineered for Outdoor Use

Designed specifically for exposed areas like roofs, gutters, and downspouts providing reliable drainage, protecting properties from leaks and roof damage.

## Range of Approved Accessories

Simplifies installation, ensuring compliance and reducing installation time.

## cCSAus Certified

Guarantees compliance with safety standards, making it suitable for a wide range of applications including hazardous areas.



## Overview

Warmup's WSR Self-Regulating Cable is specifically engineered for outdoor exposed areas for roof and gutter de-icing, providing drainage solutions for several applications. The WSR self-regulating cable helps ensure proper drainage and protection in cold weather conditions.

Its advanced positive temperature coefficient [PTC] self-regulating core is positioned between two 16 AWG multi-strand tinned copper bus wires. These are then insulated with a modified polyolefin layer which is wrapped in a tinned copper braid for grounding. The cable's outer jacket, made from modified polyolefin, ensures superior resistance to UV, abrasion, chemical, and mechanical wear, enhancing durability in harsh conditions.

The PTC self-regulating core automatically adjusts heat output in response to temperature changes, delivering more heat when snow and ice is present and reducing output as they melt ensuring energy efficient protection of roof and gutter systems.

The cable is cCSAus certified for use in Residential, Commercial & Industrial applications. Warmup provides a complete range of system accessories for the WSR cable to ensure fast and hassle-free installation. To maintain cCSAus compliance, only Warmup approved accessories may be used. Refer to the Part Numbers page for guidance.

# Construction


Modified Polyolefin  
Outer Jacket with  
UV Inhibitor

Tinned Copper  
Braid

Modified Polyolefin  
Insulation Layer

Self-Regulating  
Conductive Core

16 AWG Tinned  
Copper Bus Wire

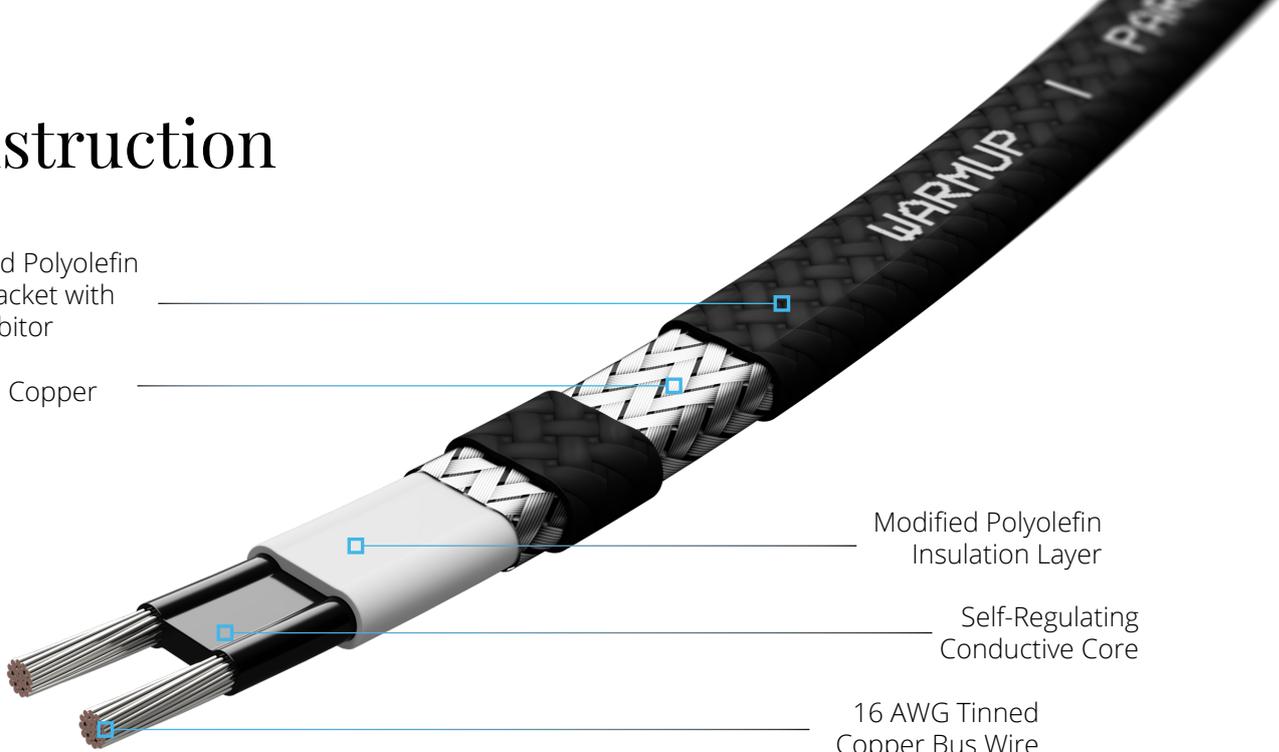

## WSR Approved Applications

Installation Type / Usage			
IEEE 515.1			CSA C22.2 No. 130:16
US	Type examples		
<b>Commercial and Industrial*</b>	<b>A</b> Insulated Surfaces (including pipes)	Hot water lines, Freeze protection, Grease lines, Fuel oil lines, Pre-insulated pipe, Below grade tracing	
	<b>B</b> Outdoor Exposed Areas†	Roof de-icing, Gutter and down spouts de-icing, Catch basins and drains	
<b>Ordinary and Hazardous Locations ‡</b>	<b>Per US (NEC 500) and CA (CE Code Annex J18)</b>		<b>CSA C22.2 No. 130:16</b>
	Class I, Division 2, Groups A, B, C and D, T5/T6††	Class II, Division 2, Groups F and G, T5/T6††	
	<b>Per US (NEC 505)</b>		
	Class I, Zone 1 AEx eb IIC T5/T6†† Gb	Class II, Zone 21 AEx tb IIIC T100°C/T85°C Db	
	<b>Per IECEx/ATEX standards</b>		
Ex 60079-30-1 IIC T5/T6†† Gb	Ex 60079-30-1 IIIC T100°C/T85°C Db	<b>Usage: WS</b> With wet test and weather resistance	

\* Commercial includes residential

\*\* Products carrying this designation are also suitable for freeze protection of fire suppression systems.

† 10W/ft cable is not CSA approved for outdoor exposed areas; Roof de-icing, gutter and down spouts de-icing, catch basins and drains

‡ For hazardous locations, WSR self-regulating cable may only be installed with Warmup accessories approved for hazardous locations [See WSR Approved Accessories]

†† T5 sets power output for WSR 12 W/ft cable; T6 sets power outputs for WSR 5, 8, and 10W/ft cable


# Technical Specifications

Model	WSR- <b>&lt;a&gt;</b> W- <b>&lt;c&gt;</b> - <b>&lt;XXX&gt;</b> d				
	WSR- <b>&lt;a&gt;</b> <b>&lt;b&gt;</b> W- <b>&lt;c&gt;</b> - <b>&lt;XXX&gt;</b> d				
Code	<b>&lt;a&gt; = 5, 8, 10 W/ft</b> <i>W/ft insulated pipe @50°F (10°C)</i>	<b>&lt;b&gt; = 9, 12, 15 W/ft</b> <i>W/ft in water @32°F (0°C)</i>	<b>&lt;c&gt; = 1 / 2</b> 1 = 110-120 V AC 2 = 208-277 V AC	<b>&lt;XXX&gt; = 250, 500 or 1000ft</b> <i>Cable length</i>	<b>&lt;d&gt; = CR</b> <i>Outer jacket material</i>
Power Output	WSR-5W	5.0 W/ft (16.4 W/m) @50°F (10°C Insulated Pipe) 6.0 W/ft (19.6 W/m) @32°F (0°C Air) 8.9 W/ft (29.2 W/m) @32°F (0°C Water)			
	WSR-8W	8.1 W/ft (26.5 W/m) @50°F (10°C Insulated Pipe) 8.7 W/ft (28.4 W/m) @32°F (0°C Air) 12.8 W/ft (42.1 W/m) @32°F (0°C Water)			
	WSR-10W *	9.3 W/ft (30.5 W/m) @50°F (10°C Insulated Pipe) 10.5 W/ft (34.3 W/m) @32°F (0°C Air) 15.3 W/ft (50.2 W/m) @32°F (0°C Water)			
Operating Voltage	110 - 120 V AC / 208 - 277 V AC				
Minimum Bend Radius	1¼" (30 mm)				
Minimum Installation Temperature	- 40 °F (- 40 °C)				
Maximum Continuous Operating Temperature	+ 150 °F (65 °C)				
Maximum Intermittent Exposure Temperature	+ 185 °F (85 °C)				
Maximum Operating Current	40A (Pipe tracing) 20A (Roof & gutter applications)				
Protective Braid Resistance	< 29 Ω/mi (18.2 Ω/km)				
Required Ground Fault Equipment Protection (GFEP)	30mA				
Dimensions	½" (12.6 mm) (W) x ¼" (6.0 mm) (T)				
Specific Weight	1.16 oz/ft (108 g/m)				
Warranty	10 Years				


\* 10W/ft cable is not CSA approved for outdoor exposed areas; Roof de-icing, gutter and down spouts de-icing, catch basins and drains

# Power Output Curves

## Specific Power Output on Pipe: WSR-xW-1

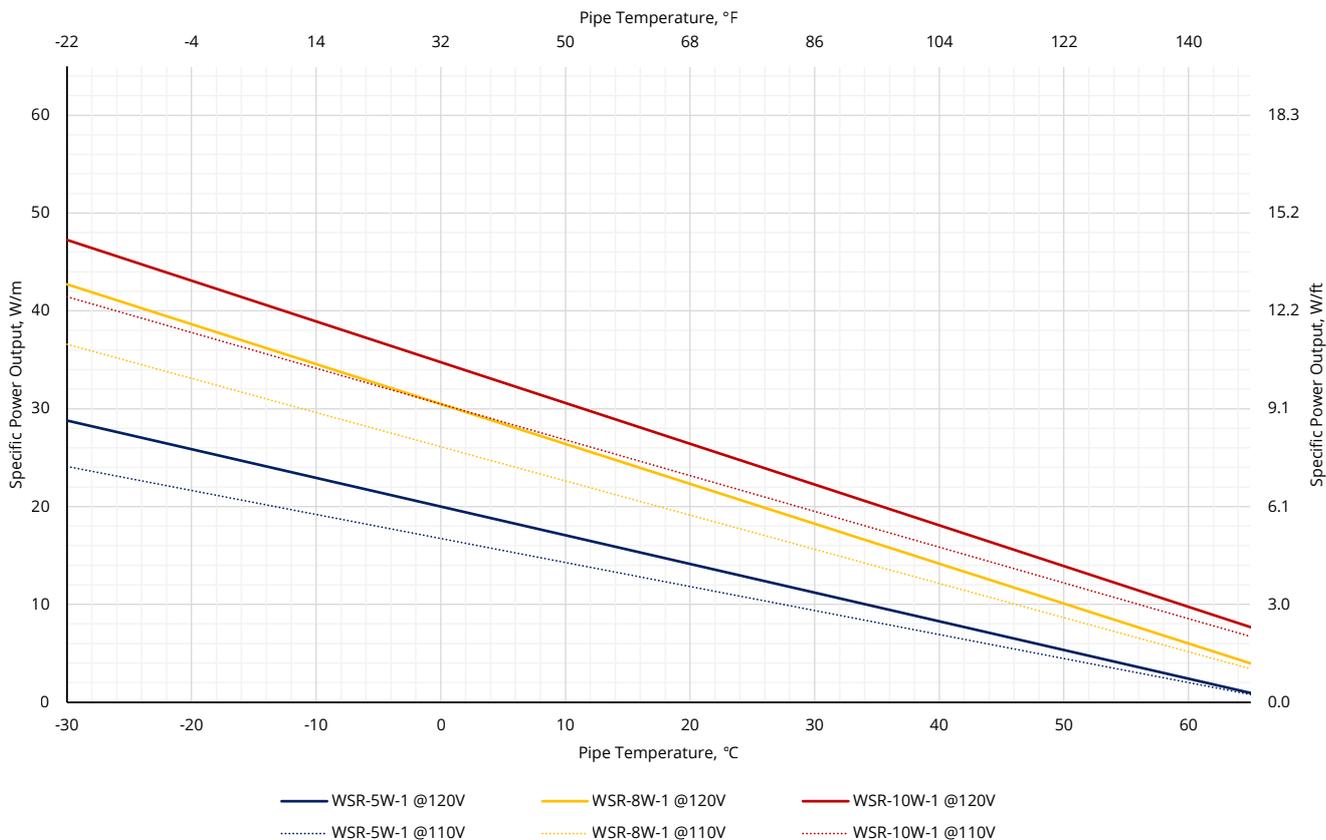


## Specific Power Output on Pipe: WSR-xW-2

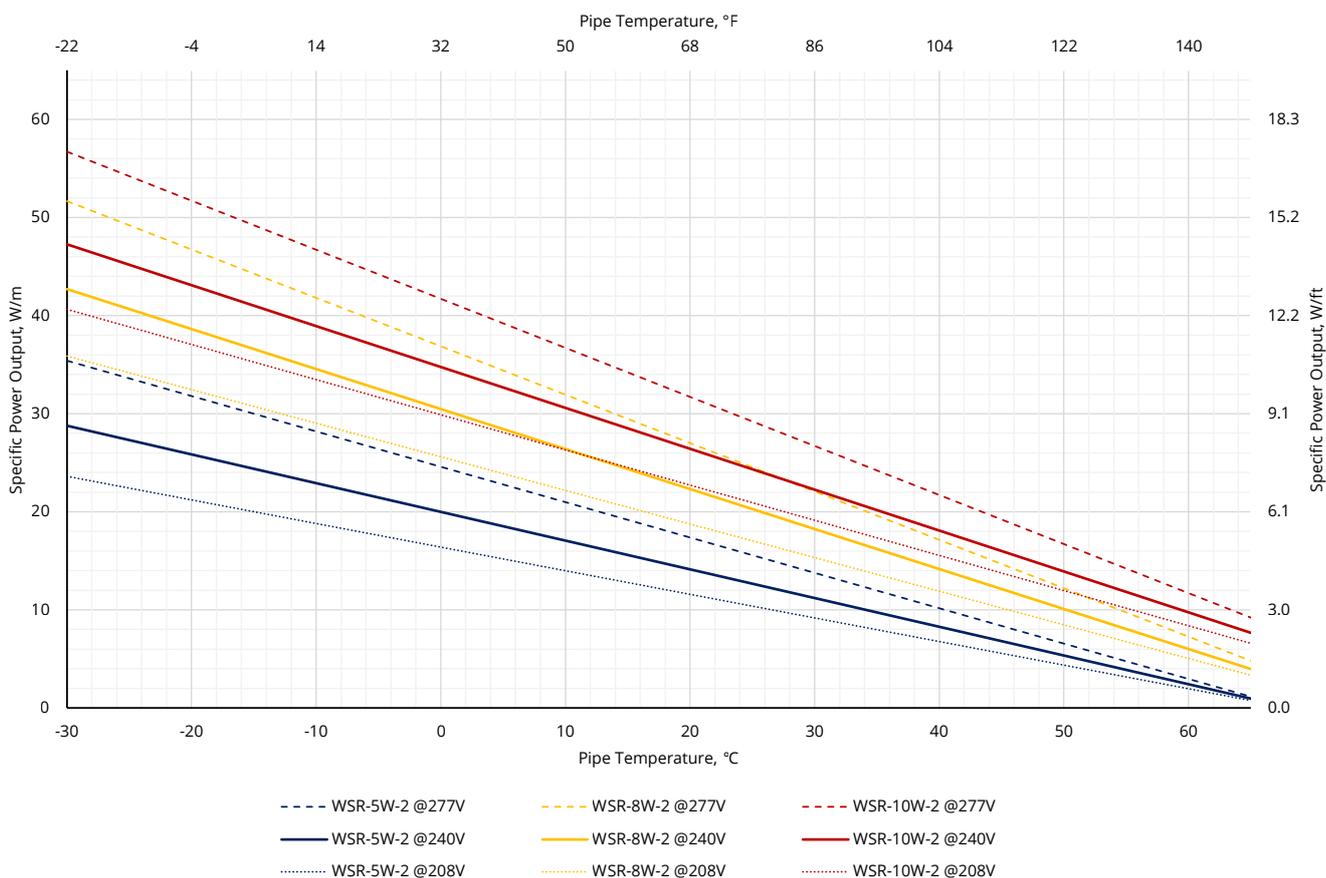


# Power Output Curves

## Specific Power Output in Water: WSR-xW-1

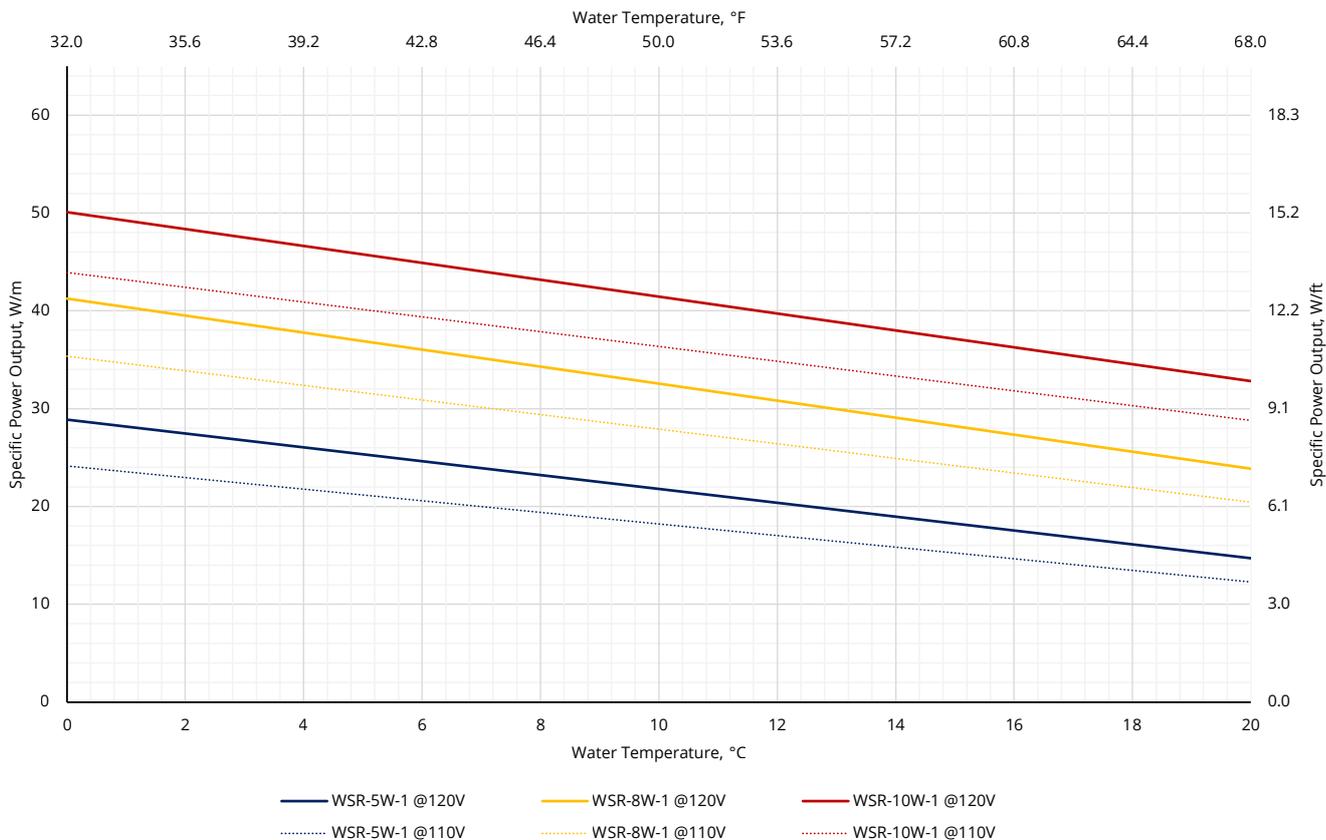


## Specific Power Output in Water: WSR-xW-2

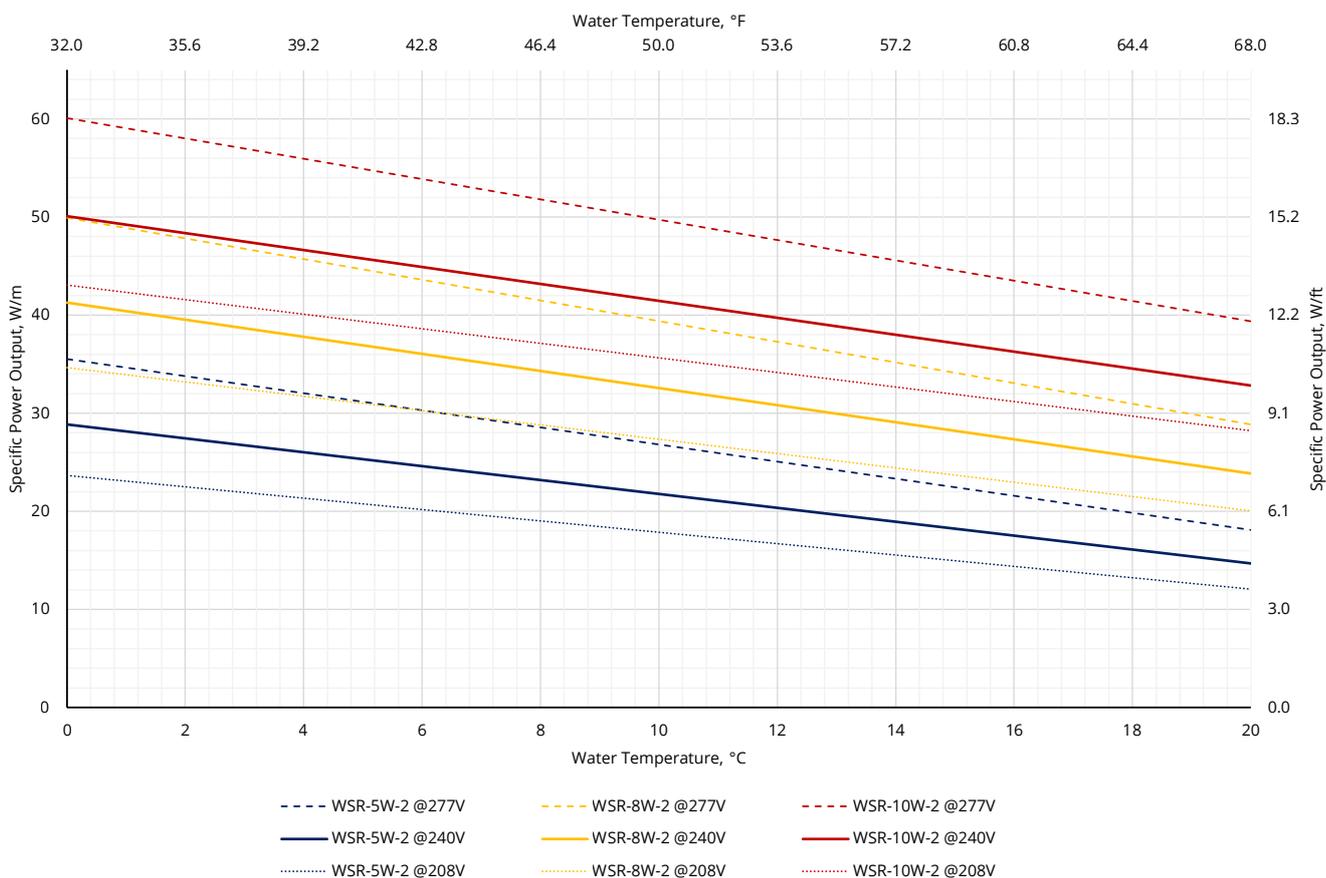


# Power Output Curves

## Specific Power Output in Air: WSR-xW-1

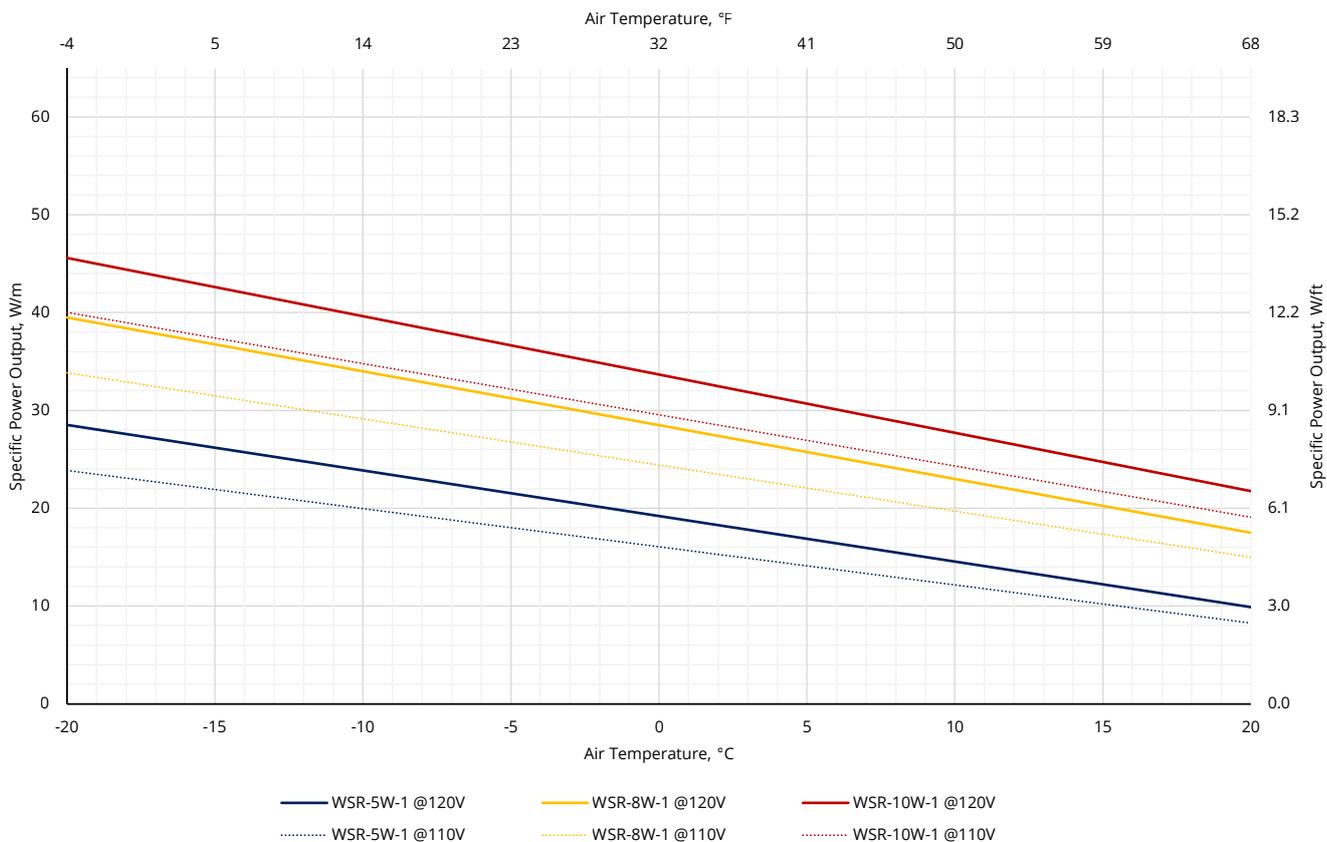

## Specific Power Output in Air: WSR-xW-2

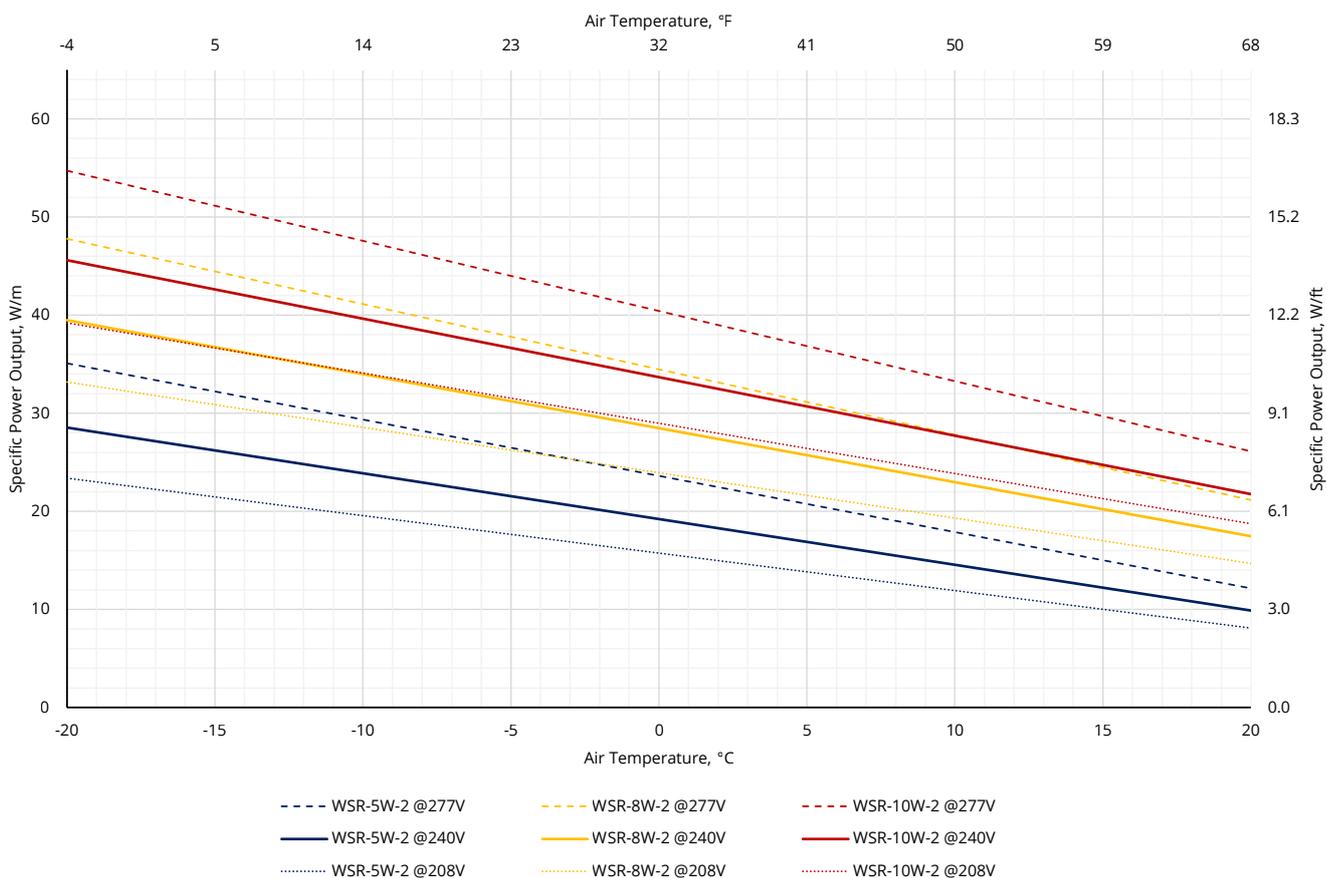

# Circuit Breaker Sizing

		120 V					208 V					240 V					277 V					
Code	Min. Start-up Temp.	15A	20A	30A	40A	50A	15A	20A	30A	40A	50A	15A	20A	30A	40A	50A	15A	20A	30A	40A	50A	
<b>Maximum Circuit Length, ft</b>																						
WSR-5W	50°F (10°C)	249	249	249	249	249	515	515	515	515	515	499	499	499	499	499	422	485	485	485	485	
	32°F (0°C)	236	238	238	238	238	491	491	491	491	491	471	476	476	476	476	383	462	462	462	462	
	14°F (-10°C)	218	228	228	228	228	472	472	472	472	472	436	456	456	456	456	354	445	445	445	445	
	-4°F (-20°C)	201	220	220	220	220	453	453	453	453	453	402	440	440	440	440	327	427	427	427	427	
	-40°F (-40°C)	174	203	203	203	203	421	421	421	421	421	347	407	407	407	407	282	377	397	397	397	
	<b>Maximum Circuit Length, meters</b>																					
	50°F (10°C)	76	76	76	76	76	157	157	157	157	157	152	152	152	152	152	129	148	148	148	148	
	32°F (0°C)	72	72	72	72	72	150	150	150	150	150	144	145	145	145	145	117	141	141	141	141	
	14°F (-10°C)	66	69	69	69	69	144	144	144	144	144	133	139	139	139	139	108	136	136	136	136	
	-4°F (-20°C)	61	67	67	67	67	138	138	138	138	138	122	134	134	134	134	100	130	130	130	130	
-40°F (-40°C)	53	62	62	62	62	128	128	128	128	128	106	124	124	124	124	86	115	121	121	121		
<b>Maximum Circuit Length, ft</b>																						
WSR-8W	50°F (10°C)	165	198	198	198	198	393	406	406	406	406	330	397	397	397	397	273	364	390	390	390	
	32°F (0°C)	150	190	190	190	190	358	387	387	387	387	301	380	380	380	380	248	331	372	372	372	
	14°F (-10°C)	138	182	182	182	182	328	371	371	371	371	276	364	364	364	364	228	304	356	356	356	
	-4°F (-20°C)	127	170	174	174	174	303	356	356	356	356	255	339	348	348	348	210	280	343	343	343	
	-40°F (-40°C)	110	147	162	162	162	263	332	332	332	332	221	294	325	325	325	182	243	319	319	319	
	<b>Maximum Circuit Length, meters</b>																					
	50°F (10°C)	50	60	60	60	60	120	124	124	124	124	101	121	121	121	121	83	111	119	119	119	
	32°F (0°C)	46	58	58	58	58	109	118	118	118	118	92	116	116	116	116	76	101	113	113	113	
	14°F (-10°C)	42	55	55	55	55	100	113	113	113	113	84	111	111	111	111	69	93	109	109	109	
	-4°F (-20°C)	39	52	53	53	53	92	109	109	109	109	78	103	106	106	106	64	85	104	104	104	
-40°F (-40°C)	34	45	49	49	49	80	101	101	101	101	67	90	99	99	99	56	74	97	97	97		
<b>Maximum Circuit Length, ft</b>																						
WSR-10W	50°F (10°C)	120	160	175	175	175	279	355	355	355	355	240	320	351	351	351	200	266	347	347	347	
	32°F (0°C)	109	145	167	167	167	253	337	338	338	338	218	290	335	335	335	181	242	331	331	331	
	14°F (-10°C)	100	133	161	161	161	232	309	324	324	324	199	266	321	321	321	166	221	316	316	316	
	-4°F (-20°C)	92	122	154	154	154	214	285	311	311	311	184	245	308	308	308	153	204	304	304	304	
	-40°F (-40°C)	80	106	143	143	143	185	247	290	290	290	160	213	285	285	285	133	177	266	283	283	
	<b>Maximum Circuit Length, meters</b>																					
	50°F (10°C)	37	49	53	53	53	85	108	108	108	108	73	97	107	107	107	61	81	106	106	106	
	32°F (0°C)	33	44	51	51	51	77	103	103	103	103	66	88	102	102	102	55	74	101	101	101	
	14°F (-10°C)	30	40	49	49	49	71	94	99	99	99	61	81	98	98	98	51	67	96	96	96	
	-4°F (-20°C)	28	37	47	47	47	65	87	95	95	95	56	75	94	94	94	47	62	93	93	93	
-40°F (-40°C)	24	32	43	43	43	57	75	88	88	88	49	65	87	87	87	41	54	81	86	86		

**NOTE:** Maximum Circuit Length is limited by; circuit breaker size (80% Capacity), in-rush current and voltage drop.

# Part Numbers

## WSR Self-Regulating Cable

Model	Code	Voltage	Cable Length	Power Output <i>W/ft insulated pipe @50°F (10°C); W/ft in water @32°F (0°C)</i>
WSR-5W-1-250-CR	WSR-5/9W-1-250-CR	110-120 VAC	250 ft	5.0 W/ft (8.9 W/ft)
WSR-5W-1-500-CR	WSR-5/9W-1-500-CR	110-120 VAC	500 ft	5.0 W/ft (8.9 W/ft)
WSR-5W-1-1000-CR	WSR-5/9W-1-1000-CR	110-120 VAC	1000 ft	5.0 W/ft (8.9 W/ft)
WSR-5W-2-250-CR	WSR-5/9W-2-250-CR	208-277 VAC	250 ft	5.0 W/ft (8.9 W/ft)
WSR-5W-2-500-CR	WSR-5/9W-2-500-CR	208-277 VAC	500 ft	5.0 W/ft (8.9 W/ft)
WSR-5W-2-1000-CR	WSR-5/9W-2-1000-CR	208-277 VAC	1000 ft	5.0 W/ft (8.9 W/ft)
WSR-8W-1-250-CR	WSR-8/12W-1-250-CR	110-120 VAC	250 ft	8.1 W/ft (12.8 W/ft)
WSR-8W-1-500-CR	WSR-8/12W-1-500-CR	110-120 VAC	500 ft	8.1 W/ft (12.8 W/ft)
WSR-8W-1-1000-CR	WSR-8/12W-1-1000-CR	110-120 VAC	1000 ft	8.1 W/ft (12.8 W/ft)
WSR-8W-2-250-CR	WSR-8/12W-2-250-CR	208-277 VAC	250 ft	8.1 W/ft (12.8 W/ft)
WSR-8W-2-500-CR	WSR-8/12W-2-500-CR	208-277 VAC	500 ft	8.1 W/ft (12.8 W/ft)
WSR-8W-2-1000-CR	WSR-8/12W-2-1000-CR	208-277 VAC	1000 ft	8.1 W/ft (12.8 W/ft)
WSR-10W-1-250-CR	WSR-10/15W-1-250-CR	110-120 VAC	250 ft	9.3 W/ft (15.3 W/ft)
WSR-10W-1-500-CR	WSR-10/15W-1-500-CR	110-120 VAC	500 ft	9.3 W/ft (15.3 W/ft)
WSR-10W-1-1000-CR	WSR-10/15W-1-1000-CR	110-120 VAC	1000 ft	9.3 W/ft (15.3 W/ft)
WSR-10W-2-250-CR	WSR-10/15W-2-250-CR	208-277 VAC	250 ft	9.3 W/ft (15.3 W/ft)
WSR-10W-2-500-CR	WSR-10/15W-2-500-CR	208-277 VAC	500 ft	9.3 W/ft (15.3 W/ft)
WSR-10W-2-1000-CR	WSR-10/15W-2-1000-CR	208-277 VAC	1000 ft	9.3 W/ft (15.3 W/ft)

## WSR Approved Accessories

Model	Description	Classification	Application
SR-SFIT-BOX-S	Power Connection Box for connecting WSR to supply	<b>Non-Hazardous &amp; Hazardous Locations</b> <i>Ex eb IIC T3 Gb, Ex tb IIIC T200°C Db Class I, Zone 1, AEx eb IIC T3 Gb Class II, Zone 21, AEx tb IIIC T200°C Db Class I, Division 2, Groups A, B, C and D T3 Class II, Division 2, Groups F, G T3</i>	Pipe Tracing Roof & Gutter
SR-SFIT-SPL	Splice Connection kit for In-line Splice of WSR cable		
SR-SFIT-TEE	Tee Splice Connection kit for Tee Splice of WSR cable		
SR-END-KIT	End-Seal Termination kit for WSR cable termination		
SR-LENDCAP	Lighted End Kit for WSR cable termination, giving visual indicator when WSR cable is active. <b>Certified for use at 120 or 240V AC only.</b>	<b>Non-Hazardous &amp; Hazardous Locations</b> <i>Class I, Division 2, Groups A, B, C and D; Class II, Division 2, Groups F and G; Class III; T5 or T6</i>	Pipe Tracing Roof & Gutter
SR-POWER-KIT	Power Connection Kit for WSR cable, incl. components for 1 power connection, 1 termination. Incl. 1 pipe standoff bracket.	<b>Non-Hazardous Locations</b>	Pipe Tracing Roof & Gutter
CRDS-15-GFCI	Plug-in, ground-fault-circuit interrupter [GFCI] power connection kit with 5-15P type plug for Warmup's WSR <b>120V Self-Regulating Cable</b>	<b>Non-Hazardous Locations</b>	Pipe Tracing Roof & Gutter
SR-SPLICE-KIT	Splice/Tee Kit for WSR cable. Incl. components for 1 Splice and 1 End Seal, or 1 Tee Connection and 1 End Seal	<b>Non-Hazardous Locations</b>	Pipe Tracing Roof & Gutter
SR-ROOF-CLIP(50/BAG)	Metal single roof clips (50/BAG) to secure WSR cable	<b>Non-Hazardous Locations</b>	Roof & Gutter
SR-HANGER-KIT	Downspout Hanger for WSR cable	<b>Non-Hazardous Locations</b>	Roof & Gutter

# Product Markings

Trade mark;  
Product type

WARMUP | PARALLEL SELF-REGULATING CABLE

<b>Model</b>	WSR- <b>&lt;a&gt;W-<b>&lt;c&gt;-<b>&lt;XXX&gt;d</b></b></b>				
<b>Code</b>	WSR- <b>&lt;a&gt;<b>&lt;b&gt;W-<b>&lt;c&gt;-<b>&lt;XXX&gt;d</b></b></b></b>				
	<b>&lt;a&gt; = 5, 8, 10 W/ft</b> W/ft insulated pipe @50°F (10°C)	<b>&lt;b&gt; = 9, 12, 15 W/ft</b> W/ft in water @32°F (0°C)	<b>&lt;c&gt; = 1 / 2</b> 1 = 110-120 V AC 2 = 208-277 V AC	<b>&lt;XXX&gt; = 250, 500 or 1000ft</b> Cable length	<b>&lt;d&gt; = CR</b> Outer jacket material
<b>Voltage Rating</b>	VOLTAGE: <b>AAA - BBB</b> VAC				
	<b>AAA = 110 / 208; BBB = 120 / 277</b>				
<b>Wattage Rating</b>	<b>&lt;#&gt;W/FT (&lt;#&gt;W/m) @50°F (10°C ON PIPE)</b>				
	<b>&lt;#&gt; = Specific power in air @50°F (10°C)</b>				
	<b>&lt;##&gt;W/FT (&lt;##&gt;W/m) @32°F (0°C WATER)</b>				
	<b>&lt;#&gt; = Specific power in water @32°F (0°C)</b>				
	<b>&lt;###&gt;W/FT (&lt;###&gt;W/m) @32°F (0°C AIR)</b>				
	<b>&lt;###&gt; = Specific power in air @32°F (0°C)</b>				
<b>Approval</b>	 CSA Approved Canada & USA	<b>268591</b>	<b>- WS</b>		
		CSA File Number	Usage marking; With wet test and weather resistance		
<b>Hazardous Location Info.</b>	<b>HAZ LOC CLASS I, DIV. 2, GROUPS A, B, C and D T5/T6   CLASS II, DIV. 2, GROUPS F and G T5/T6   CLASS I, ZONE 1 AEx eb IIC T5/T6 Gb   CLASS II, ZONE 21 AEx tb IIIC T100°C/T85°C Db   Ex 60079-30-1 IIC T5/T6 Gb   Ex 60079-30-1 IIIC T100°C/T85°C Db</b>				
	* See Guide on Hazardous Locations				
<b>Max. Temperature Rating</b>	MAX. MAINT. TEMP 149°F (65°C)				
<b>Minimum Installation Temperature</b>	- 40 °F (- 40 °C)				
<b>Amperage Rating</b>	MAX. AMPS 40**				
	** 40A rating is specific for pipe tracing applications only; <b>Outdoor exposed areas;</b> Roof de-icing, Gutter and down spouts de-icing, Catch basins and drains applications are rated at a maximum of 20A				
<b>Warning</b>	DE-ENERGIZE CIRCUIT BEFORE SERVICING				
<b>Batch Number</b>	Specific code marked on cable for traceability purposes				
<b>Feet Marking</b>	250, 500 or 1000ft				

## Contact

Warmup is available 24/7/365 at (888) 927-6333

For quotes, layouts and specific technical information contact us at:

**Warmup Inc**  
www.warmup.com  
us@warmup.com  
T: +1 (888) 927-6333

**Warmup Canada**  
www.warmup.com  
ca@warmup.com  
T: 1+ (888) 592-7687

25 Francis J Clarke Cir, Bethel,  
CT 06801

Please be advised Warmup Inc., provides these technical specifications and or instructions on a self help basis. We take every precaution to ensure they are accurate. Some of the products are sourced from manufacturers and we relay that information on to you. We do not have the technical specifications reviewed by an engineer and sometimes errors do happen. Our products are only reviewed with an ordinary level of care and when using said products in a situation that warrants additional care please be sure to conduct your own review. As such we strongly suggest before installing our products you have them reviewed by a professional engineer or qualified professional. We under no circumstances warrant our products for a particular use unless specifically agreed in writing.

# Guide to Hazardous Locations\*

---

## A Class I, Division 2 location is a location:

- (i) In which volatile flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors are handled, processed, or used, but in which the liquids, vapors, or gases will normally be confined within closed containers or closed systems from which they can escape only in case of accidental rupture or breakdown of such containers or systems or in case of abnormal operation of equipment, or
- (ii) In which ignitable concentrations of flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors are normally prevented by positive mechanical ventilation and which might become hazardous through failure or abnormal operation of the ventilating equipment, or
- (iii) That is adjacent to a Class I, Division 1 location, and to which ignitable concentrations of flammable gases, flammable liquid-produced vapors, or combustible liquid-produced vapors above their flash points might occasionally be communicated unless such communication is prevented by adequate positive-pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

---

## Class I Group Classifications

**A** Acetylene

**B** Flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value less than or equal to 0.45 mm or a minimum igniting current ratio (MIC ratio) less than or equal to 0.40

**C** Flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value greater than 0.45 mm and less than or equal to 0.75 mm, or a minimum igniting current (MIC) ratio greater than 0.40 and less than or equal to 0.80.

**D** Flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value greater than 0.75 mm or a minimum igniting current (MIC) ratio greater than 0.80.

---

## A Class II, Division 2 location is a location:

- (i) In which combustible dust due to abnormal operations may be present in the air in quantities sufficient to produce explosive or ignitable mixtures; or
- (ii) Where combustible dust accumulations are present but are normally insufficient to interfere with the normal operation of electrical equipment or other apparatus, but could as a result of infrequent malfunctioning of handling or processing equipment become suspended in the air; or
- (iii) In which combustible dust accumulations on, in, or in the vicinity of the electrical equipment could be sufficient to interfere with the safe dissipation of heat from electrical equipment, or could be ignitable by abnormal operation or failure of electrical equipment.

---

## Class II Combustible Dust Group Classifications

**F** Atmospheres containing combustible carbonaceous dusts that have more than 8 percent total entrapped volatiles (see ASTM D3175-2017, Standard Test Method for Volatile Matter in the Analysis Sample of Coal and Coke, for coal and coke dusts) or that have been sensitized by other materials so that they present an explosion hazard. [499:3.3.9.1.2] Although coal, carbon black, charcoal, and coke dusts are examples of carbonaceous dusts only those atmospheres containing combustible carbonaceous dust that have more than 8 percent total entrapped volatiles are Class II, Group F.

**G** Atmospheres containing combustible dusts not included in Group E or Group F, including flour, grain, wood, plastic, and chemicals.

---

## Equipment Temperature Class

The temperature class or operating temperature at a 104°F (40°C) ambient temperature, or at the higher ambient temperature if the equipment is rated and marked for an ambient temperature of greater than 104°F (40°C).

**T3** = ≤ 392°F (≤ 200°C); **T5** = 212°F (≤ 100°C); **T6** = ≤ 185°F (≤ 85°C)

---

## A Zone 1 location is a location

- (i) In which ignitable concentrations of flammable gases or vapors are likely to exist under normal operating conditions; or
- (ii) In which ignitable concentrations of flammable gases or vapors may exist frequently because of repair or maintenance operations or because of leakage; or
- (iii) In which equipment is operated or processes are carried on, of such a nature that equipment breakdown or faulty operations could result in the release of ignitable concentrations of flammable gases or vapors and also cause simultaneous failure of electrical equipment in a mode to cause the electrical equipment to become a source of ignition; or
- (iv) That is adjacent to a Zone 0 location from which ignitable concentrations of vapors could be communicated, unless communication is prevented by adequate positive pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

# Guide to Hazardous Locations\*

---

## A Zone 21 location is a location where one of the following apply:

- (i) Ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings are likely to exist occasionally under normal operating conditions.
- (ii) Ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings might exist frequently because of repair or maintenance operations or because of leakage.
- (iii) Equipment is operated or processes are carried on of such a nature that equipment breakdown or faulty operations could result in the release of ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings and also cause simultaneous failure of electrical equipment in a mode to cause the electrical equipment to become a source of ignition.
- (iii) The location is adjacent to a Zone 20 location from which ignitable concentrations of combustible dust, combustible fibers/flyings, or ignitable fibers/flyings could be communicated.  
*Exception: When communication from an adjacent Zone 20 location is minimized by adequate positive pressure ventilation from a source of clean air, and effective safeguards against ventilation failure are provided.*
- (iv) Group IIIC combustible dusts are present in hazardous quantities occasionally, under normal or abnormal operating conditions, or frequently because of repair or maintenance operations or because of leakage.

---

## Symbols explained

**AEx** The symbol AEx identifies the equipment as meeting American national standards. The symbol Ex is used in European Union countries. Only equipment marked AEx has been evaluated for use in electrical systems and hazardous locations covered by the NEC

---

## Equipment Suitable for Hazardous (Classified) Locations

Mark	NEC Area Classification	Type (Level) of Protection
<b>eb</b>	Zone 1	Increased safety (Group II)
<b>tb</b>	Zone 21	Protection by enclosure (Group III)

---

## Equipment Protection Level

The EPL indicates the level of protection provided by the equipment and is correlated to the zone in which the equipment will be installed and operated.

Mark	NEC Area Classification	Type (Level) of Protection
<b>Gb</b>	Zone 1	equipment for explosive gas atmospheres, having a "high" Level of Protection, which is not a source of ignition in normal operation or during expected malfunctions
<b>Db</b>	Zone 21	equipment for explosive dust atmospheres, having a "high" Level of Protection, which is not a source of ignition in normal operation or during expected malfunctions

---

## Material Groups

**IIC** Group IIC: Atmospheres containing acetylene, hydrogen, or flammable gas, flammable liquid-produced vapor, or combustible liquid-produced vapor mixed with air that may burn or explode, having either a maximum experimental safe gap (MESG) value less than or equal to 0.50 mm or minimum igniting current (MIC) ratio less than or equal to 0.45.

**IIIC** Group IIIC: Combustible metal dust, including combustible metal fibers/flyings.

*Equipment marked Group IIIC shall be permitted for applications requiring Group IIIA or Group IIIB equipment.*

---

## IECEx/ATEX standards

**Ex** The symbol Ex is used in European Union countries.

**60079-30-1** STANDARD FOR SAFETY  
Explosive Atmospheres – Part 30-1: Electrical Resistance Trace Heating – General and Testing Requirements

---

\* This guide is provided for reference purposes only. It summarizes typical classifications and installation types based on information from the National Electrical Code (NEC), Canadian Electrical Code (CEC), and relevant international standards.

**This guide does not replace or supersede any official code or standard.** For the most accurate and up-to-date requirements, always consult the NEC, CEC, and applicable local regulations, as well as the latest versions of IECEx/ATEX standards. Installation in hazardous locations must comply with all certification conditions and use only Warmup approved accessories as specified in the product documentation.